





## CHULA VISTA FIRE DEPARTMENT

### FIRE PREVENTION DIVISION

#### Detail A - Single Occupant Building

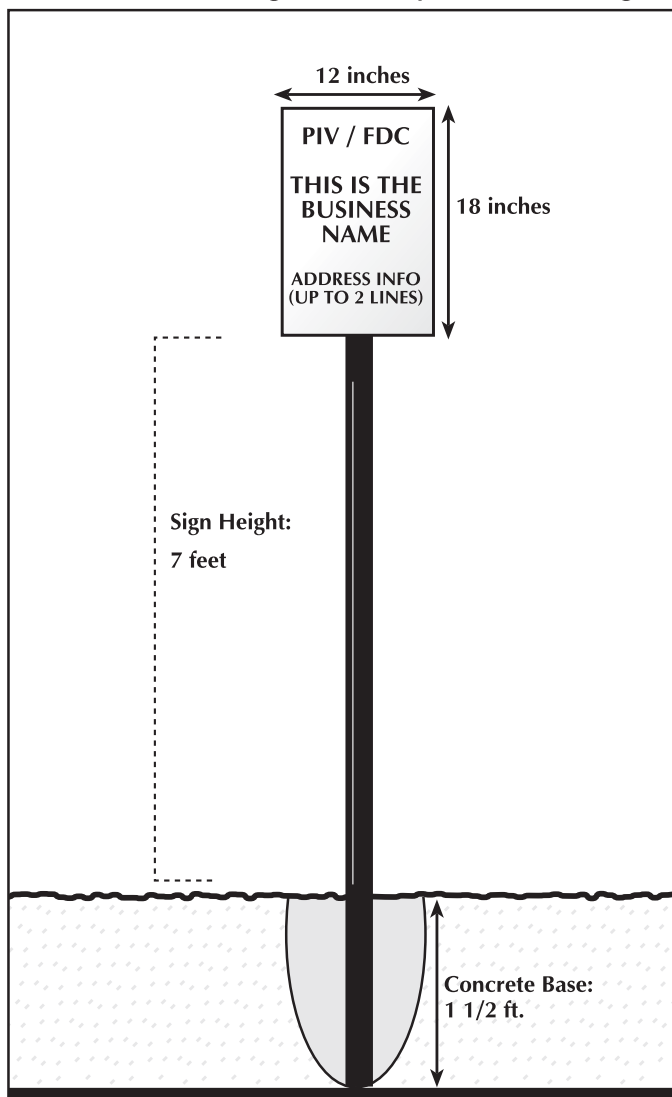

#### Detail B - Multiple Occupant Building

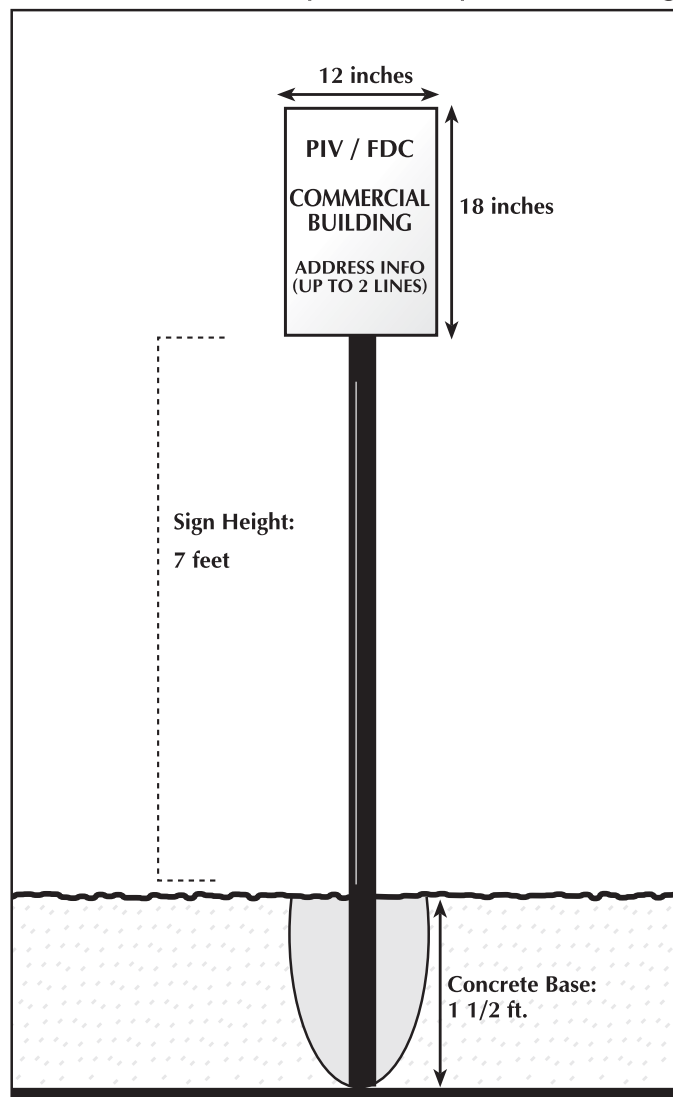

#### Sign Specifications

1. Measurements MUST be exact and will be subject to a field inspection
2. Sign must be .080 gauge aluminum
3. Holes and radii must adhere to FHWA standards
4. Sign must be Type IV high intensity prismatic sheeting [H.I.P.]
5. Protective overlay film on sign [P.O.F.]
6. Sign support pole: schedule 40, 2-inch galvanized pipe
7. Sign must be buried in concrete base buried 1 1/2 feet deep
8. Signage letter height:
  - PIV/FDC and business name = 1 1/2 inches tall
9. White background with black lettering